

CERTIFICATE

No: 000201/05

In accordance with the **CertAlarm** Rules and Certification scheme type 5, as defined in ISO/IEC 17067, we Telefication B.V. certify that the product

HS2128

is in conformity with the following standard(s)

EN 50131-10

Alarm systems - Intrusion and hold-up systems - Part 10: Application specific requirements for Supervised Premises Transceiver (SPT)

EN 50131-3

Alarm systems - Intrusion and hold-up systems - Part 3: Control and indicating equipment

EN 50131-6

Alarm systems - Intrusion and hold-up systems - Part 6: Power supplies

EN 50136-2

Alarm systems - Alarm transmission systems and equipment - Part 2: Requirements for Supervised Premises Transceiver (SPT)

Digital Security Controls, a div. of Tyco Safety Products Canada Ltd.

95 Bridgeland Ave.

M6A1Y7 Toronto

Canada

is authorised to use the CERTALARM Mark on the above mentioned product.

This certificate is valid until:

29 November 2022

Zevenaar, 29 November 2018

Signed on behalf of Telefication B.V.



Jan Willem Verwoert
Project Manager



CERTIFICATE

No: 000201/05 - Annex No 1

Takes into account the following product and variants:

- Product description: I&HAS Control Panel (hosted in PC5003C or PC5006C metal enclosure)
- Trademark: DSC/Tyco
- Type designation: HS2128
- Hardware version: UA621 Rev. 03
- Software version: Ver. 1.3

- Product description: Control Panel (hosted in PC5003C or PC5006C metal enclosure)
- Trademark: DSC/Tyco
- Type designation: HS2064
- Hardware version: UA621 Rev. 03
- Software version: Ver. 1.3

- Product description: Control Panel (hosted in PC5003C or PC5006C metal enclosure)
- Trademark: DSC/Tyco
- Type designation: HS2032
- Hardware version: UA621 Rev. 03
- Software version: Ver. 1.3

- Product description: Control Panel (hosted in PC5003C or PC5006C metal enclosure)
- Trademark: DSC/Tyco
- Type designation: HS2016
- Hardware version: UA621 Rev. 03
- Software version: Ver. 1.3

The optional features of the specifications that are included in the product and test report:

Equipment Security grade: 2
Equipment Environmental class: II
Equipment class: Fixed
SPT structure : Type Z
ATS category : Custom category C

HS2128, HS2064, HS203 and HS2016 can be hosted in PC5003C or PC5006C metal enclosure

This equipment can be applied in EN 50131-1 compliant systems up to and including security grade 2.
Electromagnetic emission and safety aspects are not covered by this certificate.

Factory location:
Digital Security Controls, a div. of Tyco Safety Products Canada Ltd.
95 Bridgeland Ave.
M6A1Y7 Toronto
Canada


CERTIFICATE

No: 000201/05 - Annex No 1

Storage location:
AnB Rimex SA
Rue de l'Abbaye 89
4040 Herstal
Belgium

Test Reports:

- Nemko Canada Inc.: 313565-2R1TRFEMC (EN 50130-4), 28 November 2016
- Telefication: 20134020800 -Ver1.00, 19 January 2015
- Telefication: 20134020801, 30 December 2013
- Telefication: 20134020802 -Ver 1.00, 19 January 2015
- Telefication: 161001859-001 Ver 1.00, 22 December 2016
- Nemko Canada Inc.: HS2 System EN50130-4 Nemko Test Report 238276-1TRFEMC, 05 July 2013
- Telefication: 170500548-001-Ver 1.00, 08 June 2017

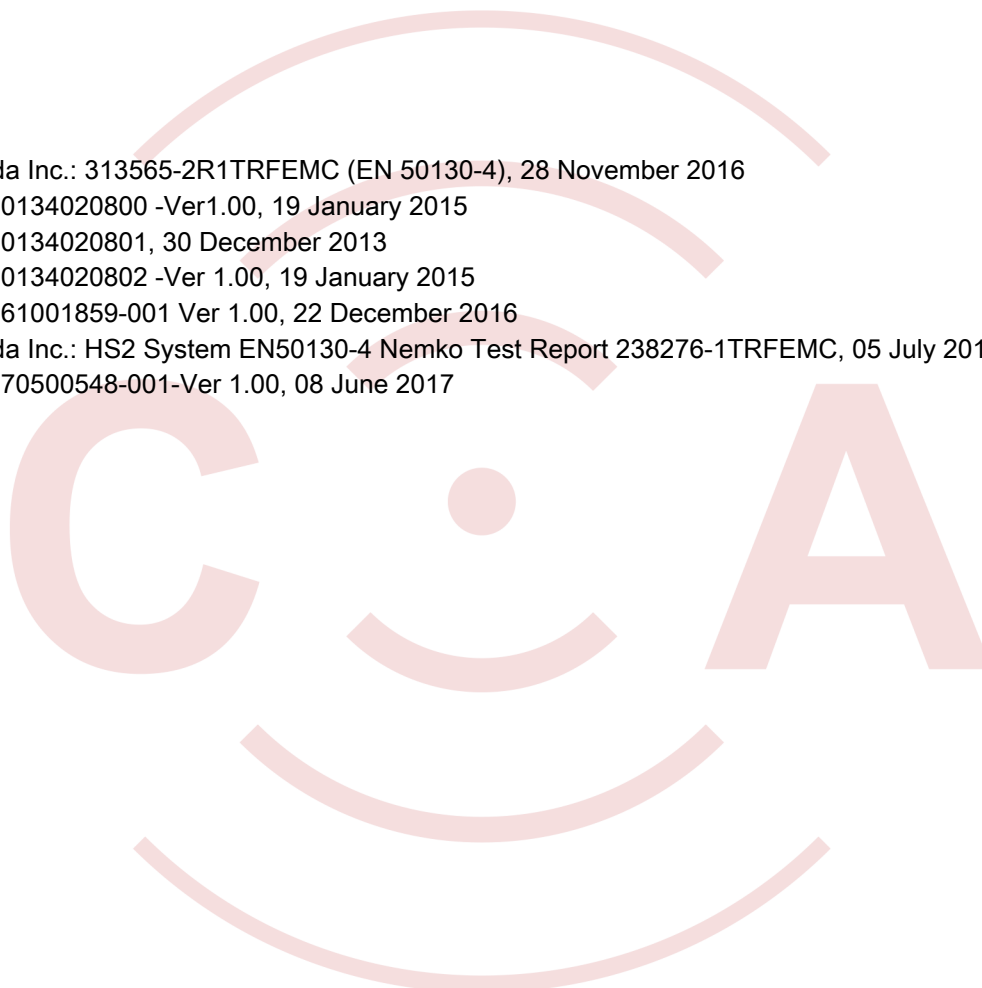

CERTIFICATE

No: 000201/05 - Annex No 2

Validity of Certificate:

The Certificate remains valid based upon satisfactory annual factory production control audits for Fire products or biennial factory production control audits for Security products and follow up re-testing as required by CertAlarm scheme rules.

Documents submitted:

- Assembly drawings
- Bill of material / Parts list
- Electronic schematics
- Manual
- Internal / external photos
- Label and label placement
- RF_071_02 Request for prolongation of an Alarm Certificate - HS2128_HS20...

DISCLAIMER:

The validity of this certificate is limited to products, which are equal to the one(s) examined.